




# Water System Operations Manager's Report

Engineering and Operations Committee  
Item 7a  
June 7, 2010

# Current Operations

- Blends at Weymouth, Diemer and Skinner at 25 percent State Project Water
- Blends are projected to remain at 25 percent State Project Water through the Summer
- May demands of 156 TAF were about 35 TAF lower than May 2009
- Shutdowns
  - Yorba Linda Feeder: June 4
  - Allen-McColloch Pipeline: June 8

# Metropolitan Distribution System

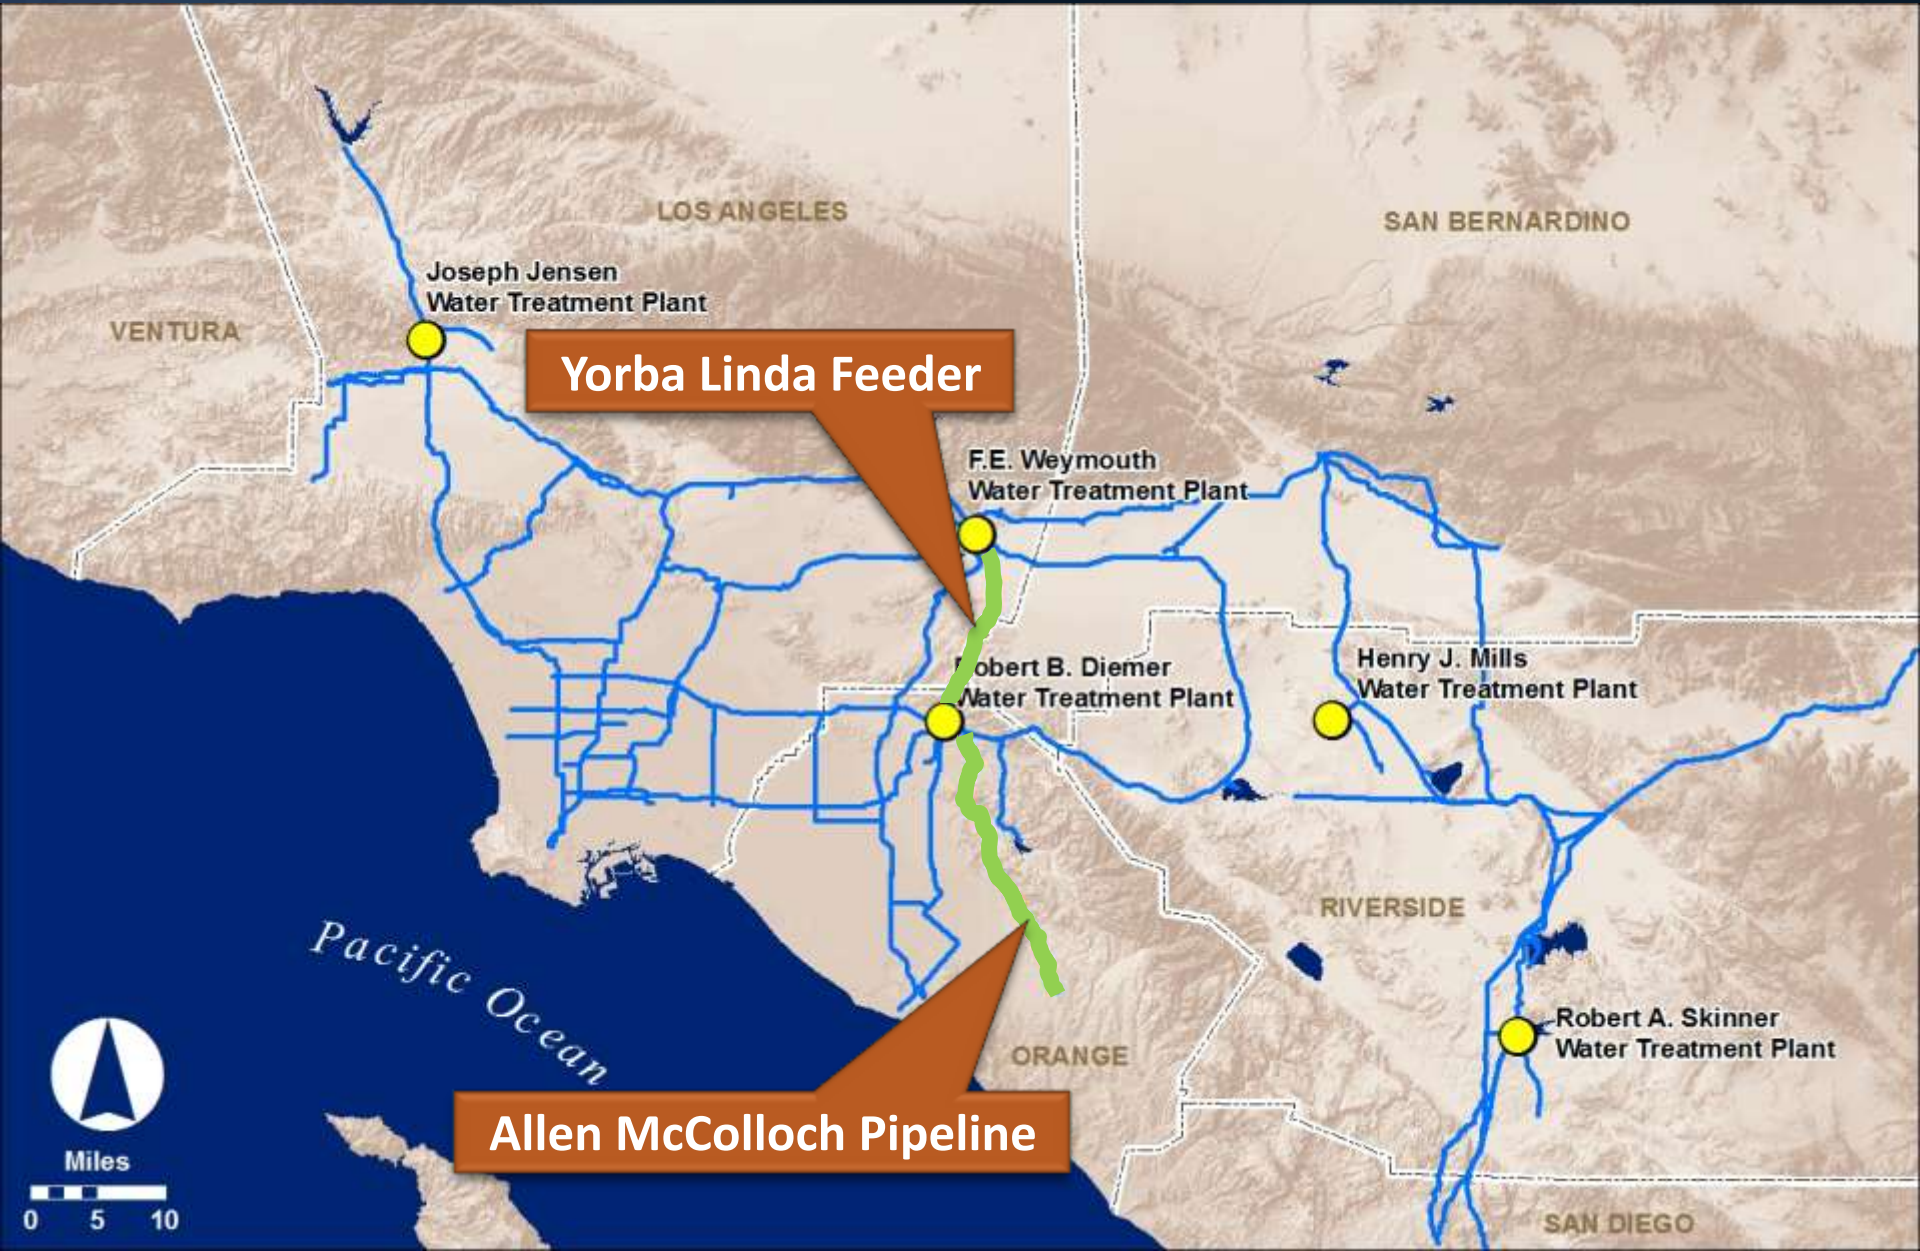

# Diamond Valley Lake

## Storage Levels



DVL: 49% of 810 TAF Maximum Storage



