



# Engineering Services Group Manager's Report

Engineering and Operations Committee

Item 7b


October 10, 2011

# Inland Feeder Program

- up to 1,000 cfs
- 12-foot diameter
- 18 miles of tunnel
- 26 miles of pipeline

Arrowhead West Tunnel

Arrowhead East Tunnel

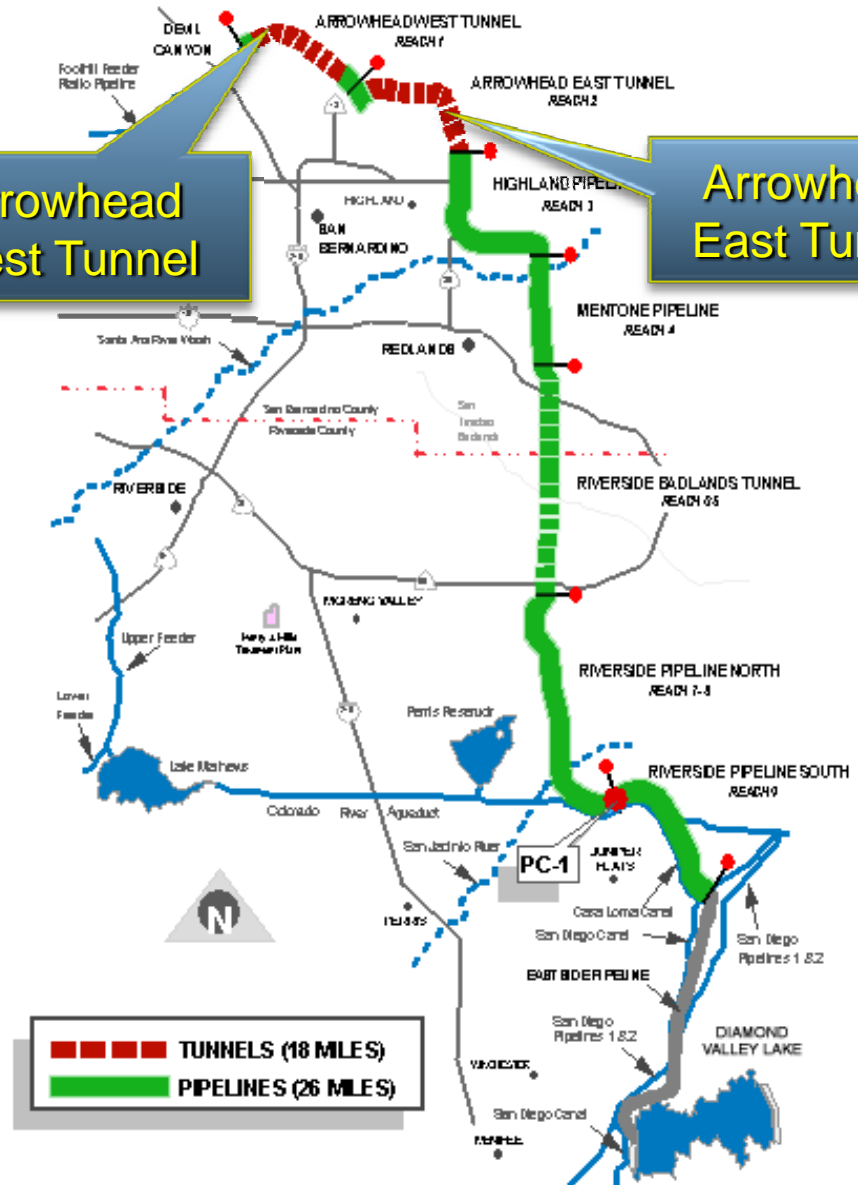

# Arrowhead Tunnels




# Weymouth Water Treatment Plant

## Power System Upgrades



New 2250 kW Diesel Standby Generator

# Weymouth Water Treatment Plant Maintenance Shops Upgrades

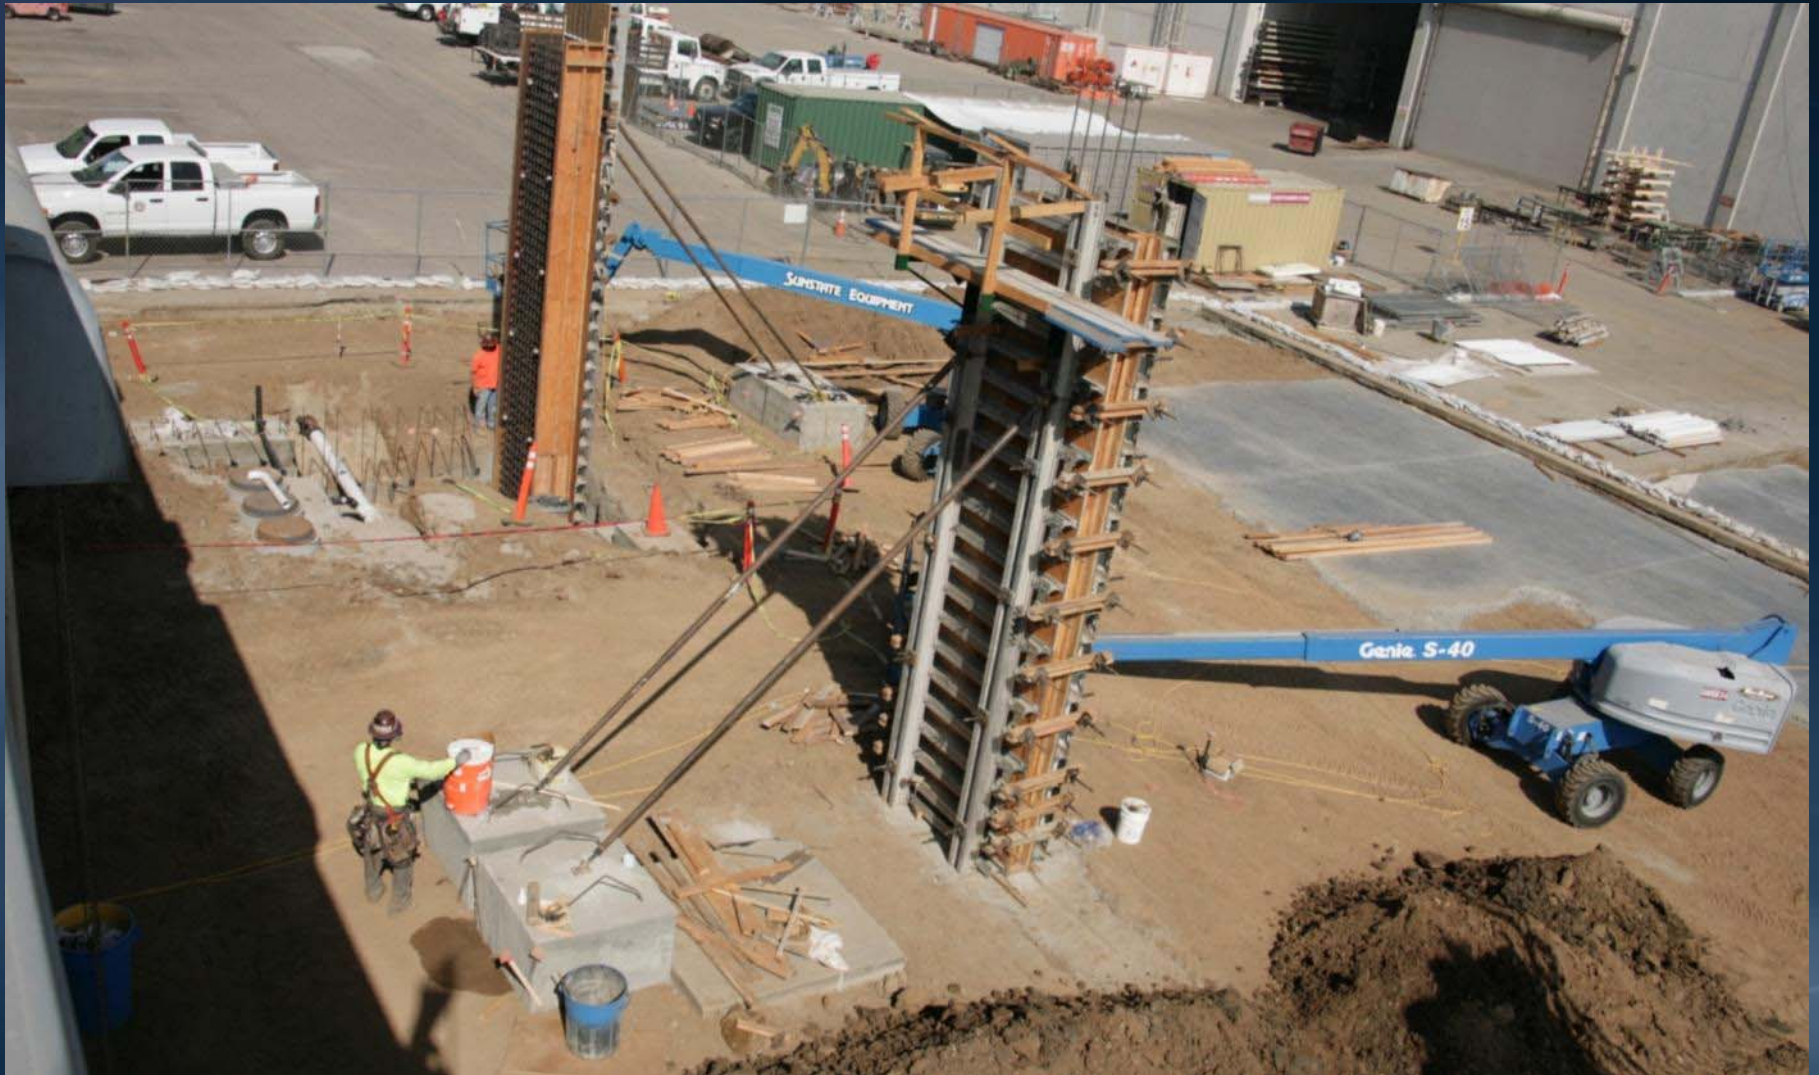

Coating Shop expansion

# Weymouth Water Treatment Plant

## Coagulant Tank Farm Modifications



Completed canopy structure

# Diemer Water Treatment Plant

## Fire and Potable Water Pump Station



Unit Power Center slab construction

# Diemer Water Treatment Plant

## North Access Road



Paved roadway at Carbon Canyon Creek Bridge



