



# Water System Operations Manager's Report


Engineering and Operations Committee  
Item 7a  
April 9, 2012

# Current Operations

- SWP blend targets are 45% at Weymouth, 35% at Diemer, and 35% at Skinner
- March 2012 demands of 117 TAF were about 35 TAF higher than March 2011
- The CRA was returned to service on March 24<sup>th</sup> and is currently at a 7 pump flow
- 2012 SWP Allocation remains at 50%


# Lake Oroville and Shasta Lake

## Storage Levels

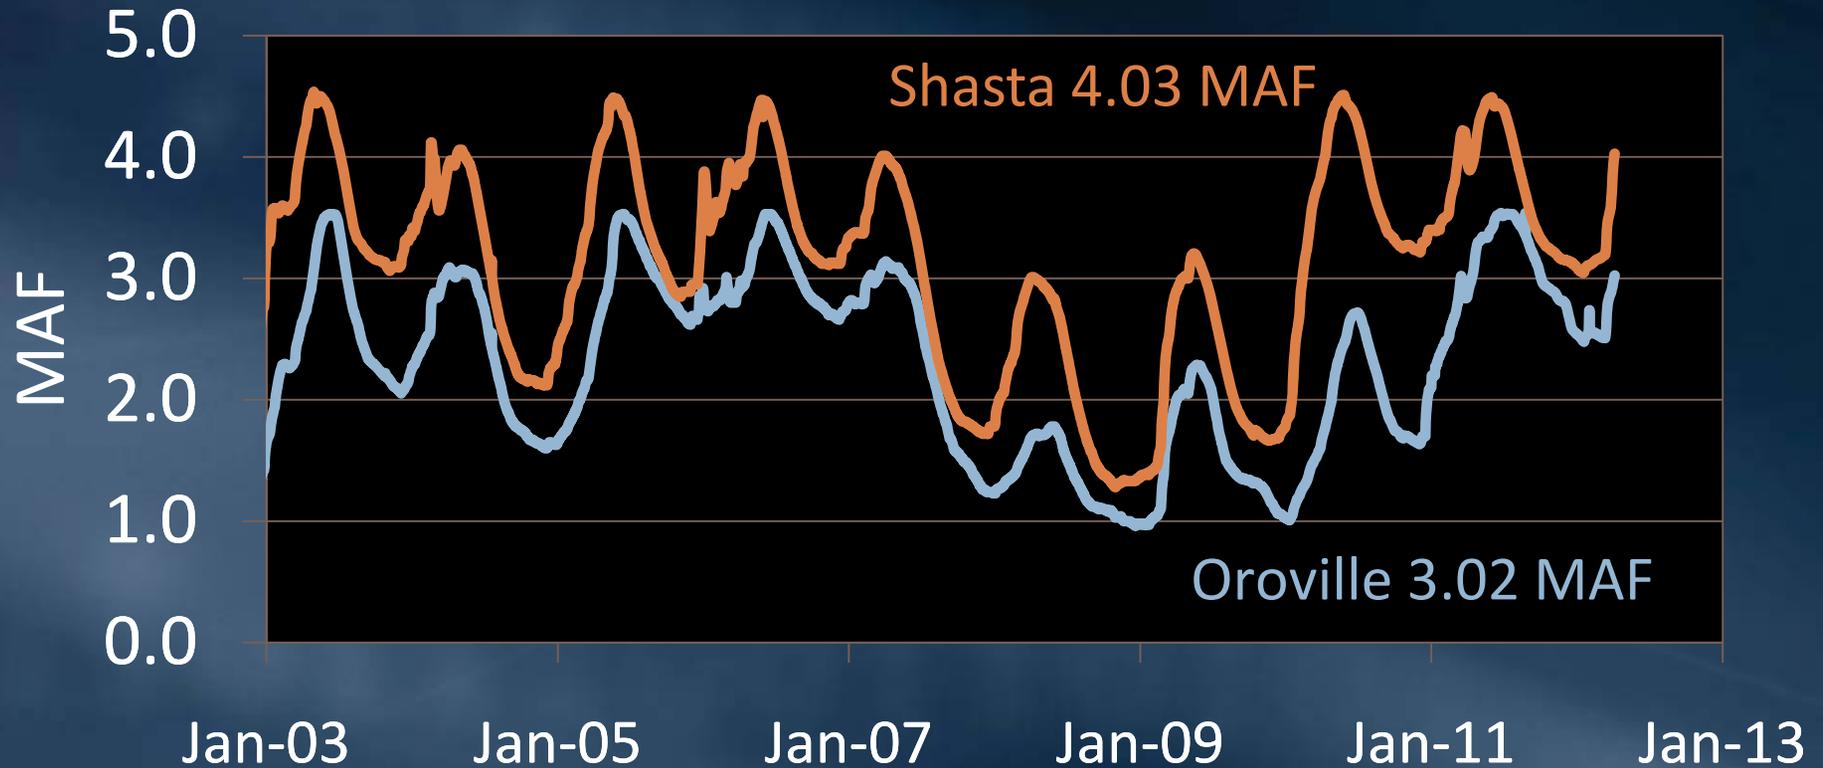

Shasta: 88% of 4.55 MAF Maximum Storage  
Oroville: 86% of 3.53 MAF Maximum Storage

# Rialto Pipeline – April 3-4

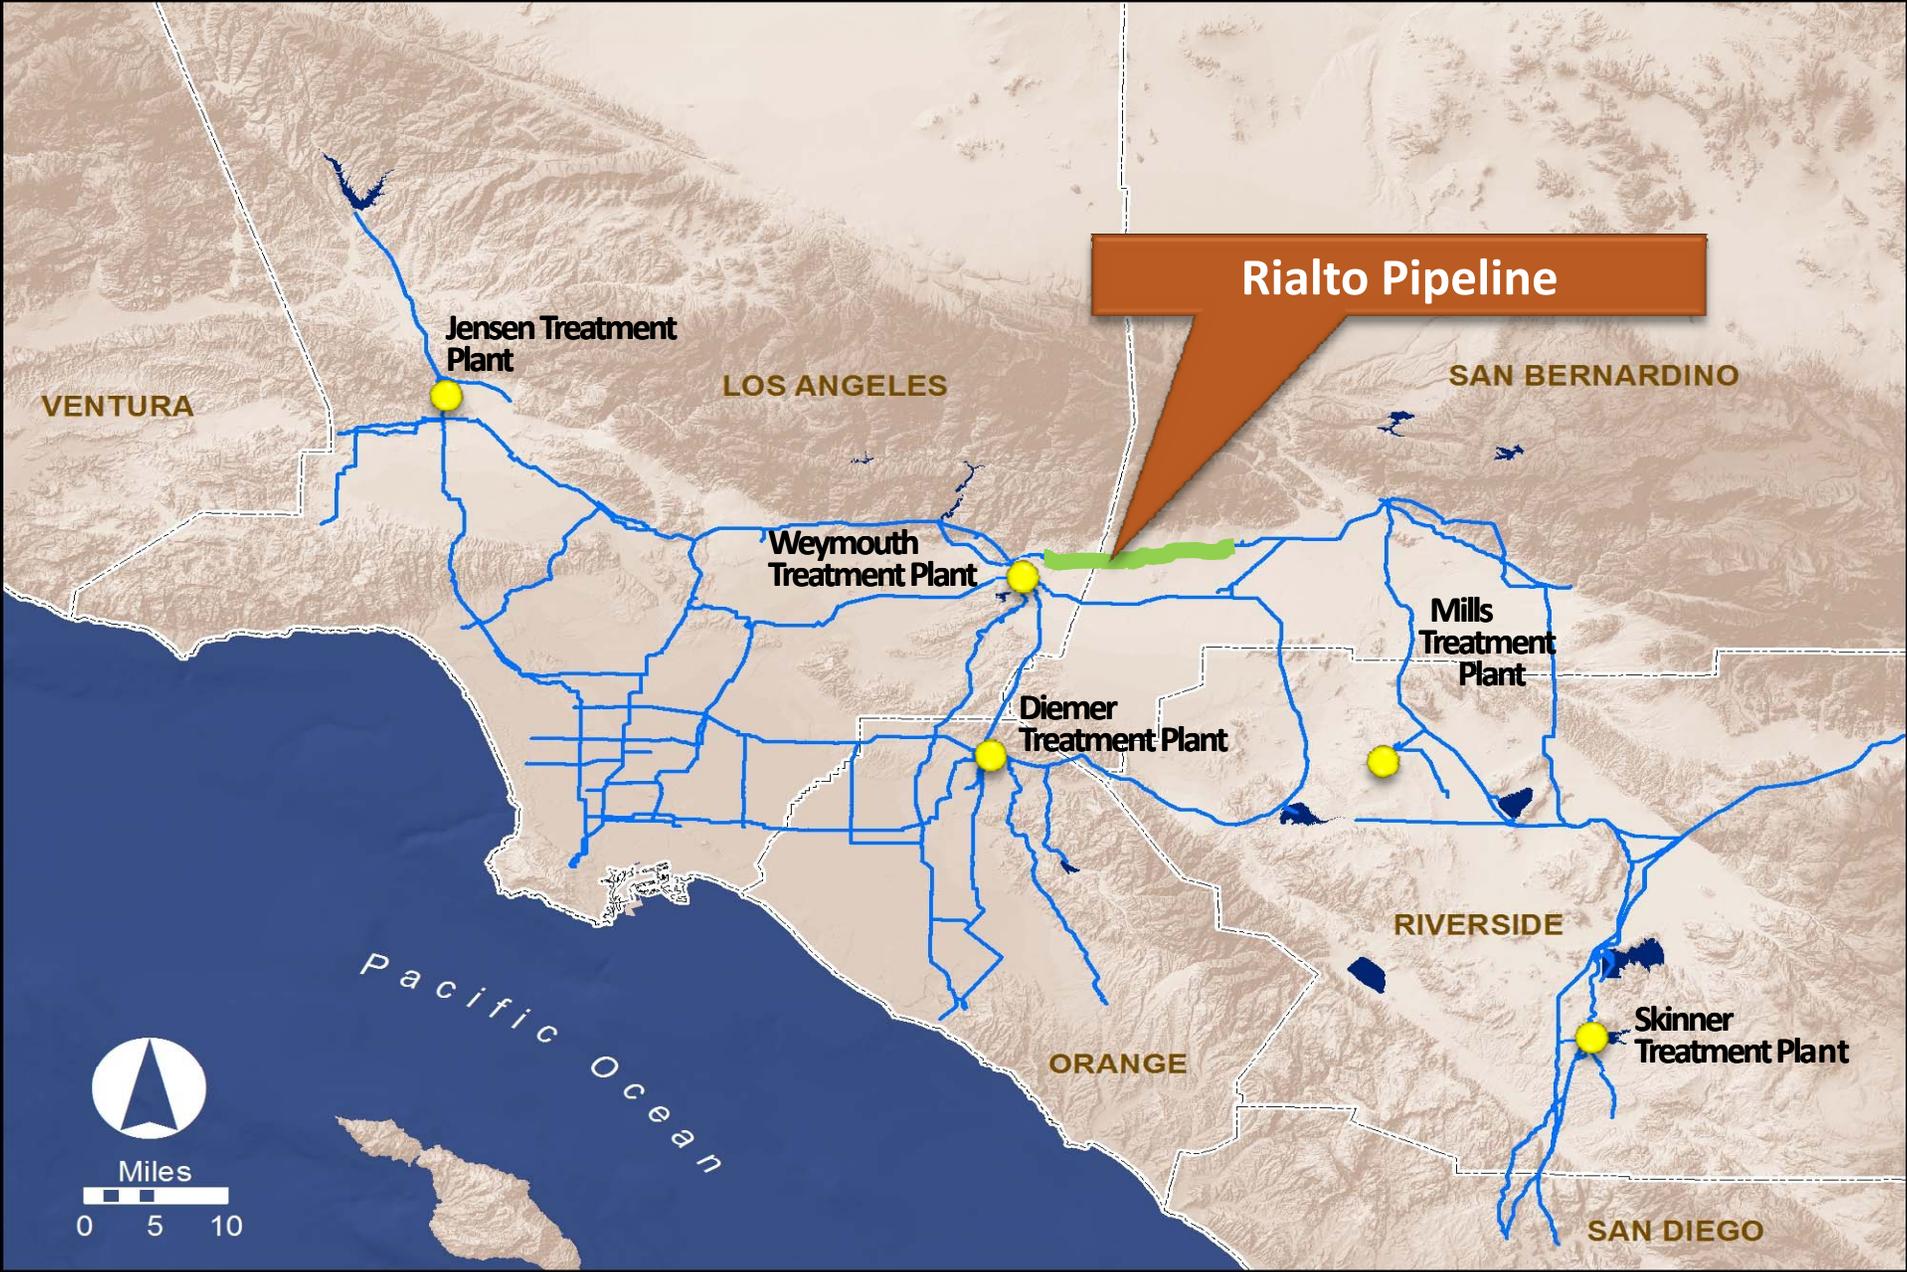

# Rialto Pipeline Shutdown



# Rialto Pipeline Shutdown



E&O Committee

7a

April 2012