



# Water System Operations Manager's Report

Engineering and Operations Committee

Item 7a

May 7, 2012


# Current Operations

- SWP blend targets are 60% at Weymouth, Diemer, and Skinner
- April 2012 demands of 135 TAF were about 36 TAF higher than April 2011
- The CRA is currently at a 7 pump flow
- 2012 SWP Allocation increased to 60%



# Lake Oroville and Shasta Lake

## Storage Levels

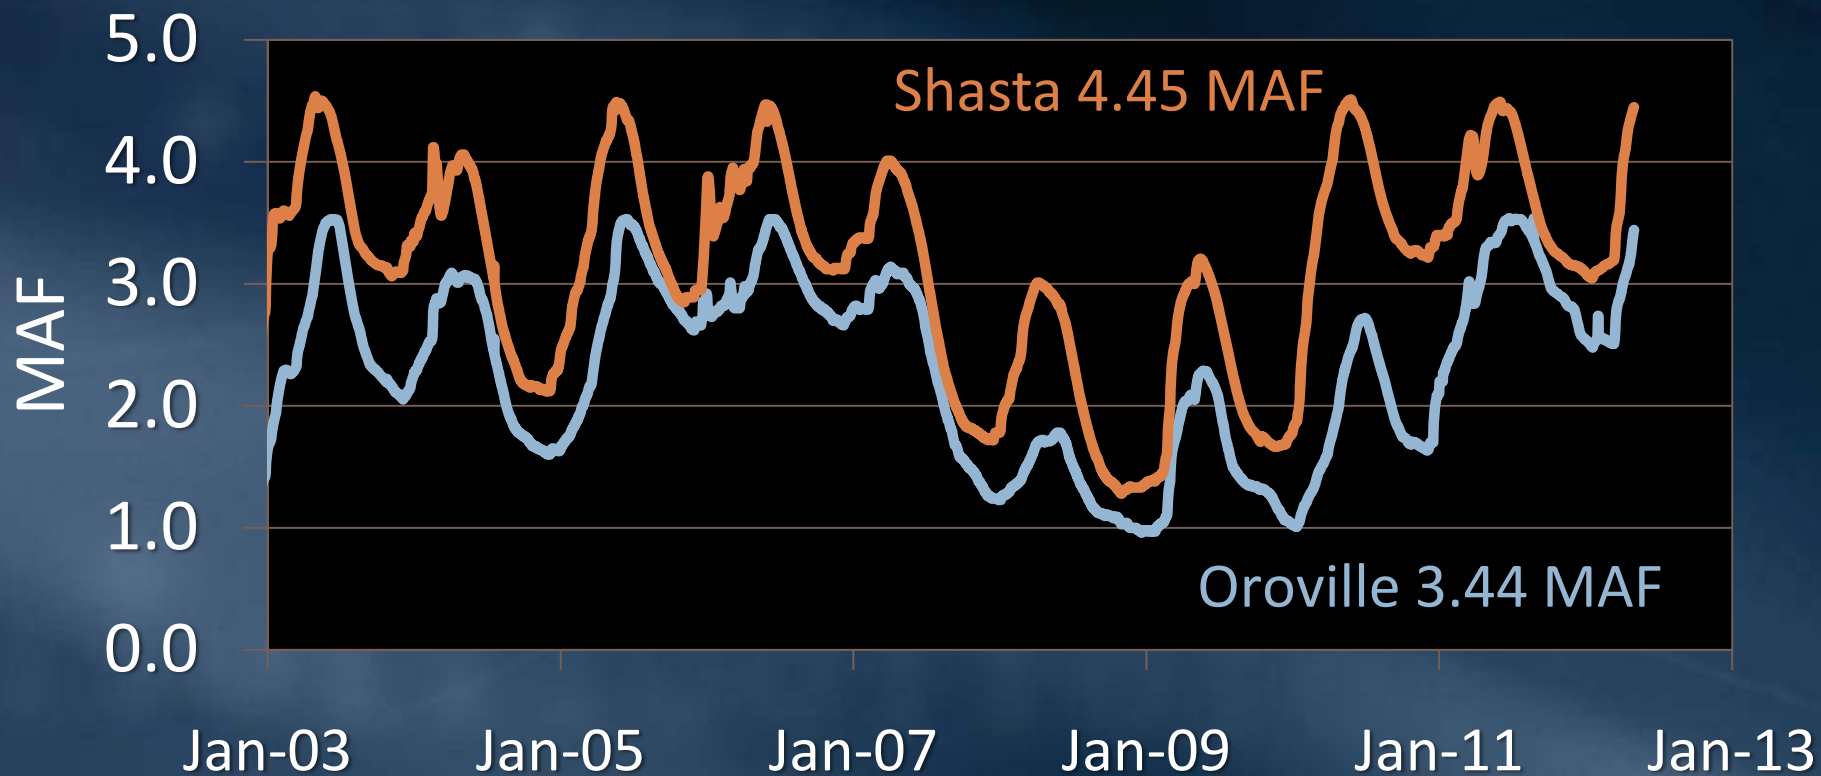

Shasta: 98% of 4.55 MAF Maximum Storage

Oroville: 97% of 3.53 MAF Maximum Storage

# Salinity Management Workshop

- USBR, Metropolitan, and Southern California Salinity Coalition will host salinity workshop on June 1
- Invitations and pre-workshop survey sent to ~100 agencies and organizations
- Workshop to discuss regional progress in salt management, and identify current challenges and long-term solutions

