



Joseph Jensen Water Treatment Plant Service Water Pumps

Engineering & Operations Committee

Item 7-4

March 11, 2013

Current Action

- Appropriate \$620,000
- Award \$529,802.09 procurement contract to Multi W Systems, Inc. to furnish 8 service water pumps

Distribution System



Jensen Plant



Background



Service Water Pumps

Service water pumps supply filtered water for chlorine disinfection & chemical feed systems

Background

- 20 to 40 years in service
- Pumps are cracked, deteriorated & leak
- Jensen Filter Surface Wash Upgrades contract awarded in January 2013
- Pump installation by the Filter Surface Wash Upgrades contractor



cracked pump housing



Procurement Bid Results

Request for Bids No. RFB-KK-259138


Bids Received:	2/12/13
No. of bidders:	3
Low bidder:	Multi W Systems, Inc.
Low Bid:	\$529,802.09
Other Bids:	\$571,424 to \$604,199
Budgetary Cost Estimate:	\$532,000

Requested Funds

Labor

Submittals review & responses to RFIs	\$ 23,000
Fabrication inspection & testing	\$ 32,000
Project mgmt & controls	\$ 10,000
Procurement contract	\$ 529,803
Remaining budget	\$ 25,197
<hr/>	
Total	\$ 620,000

Project Schedule

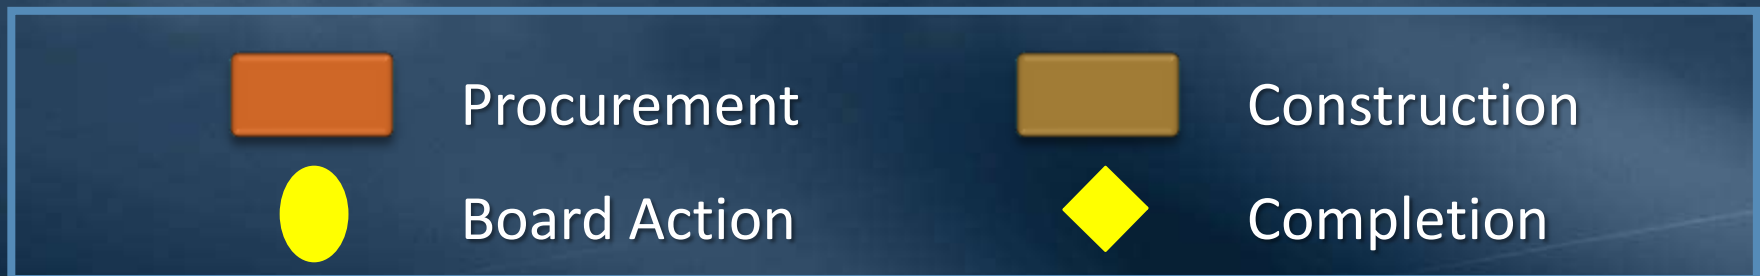

Board Options

- Option #1
 - Adopt CEQA determination
 - Appropriate \$620,000
 - Award \$529,802.09 procurement contract to Multi W Systems, Inc. for Jensen service water pumps
- Option #2
 - Do not award the contract & re-advertise

Staff Recommendation

- Option #1

