



Water System Operations Manager's Report

Engineering and Operations Committee

Item 7a

April 11, 2016

Current Operational Conditions


- 2016 SWP Allocation at 45%
- SWP blend targets are 0% at Weymouth, Diemer, and Skinner
- Deliveries to DVL began March 22, 2016
- The CRA is currently at a 7 pump flow
- March 2016 demand of 120 TAF is 37 TAF lower than March 2015

Castaic Lake




Diamond Valley Lake

March 2016

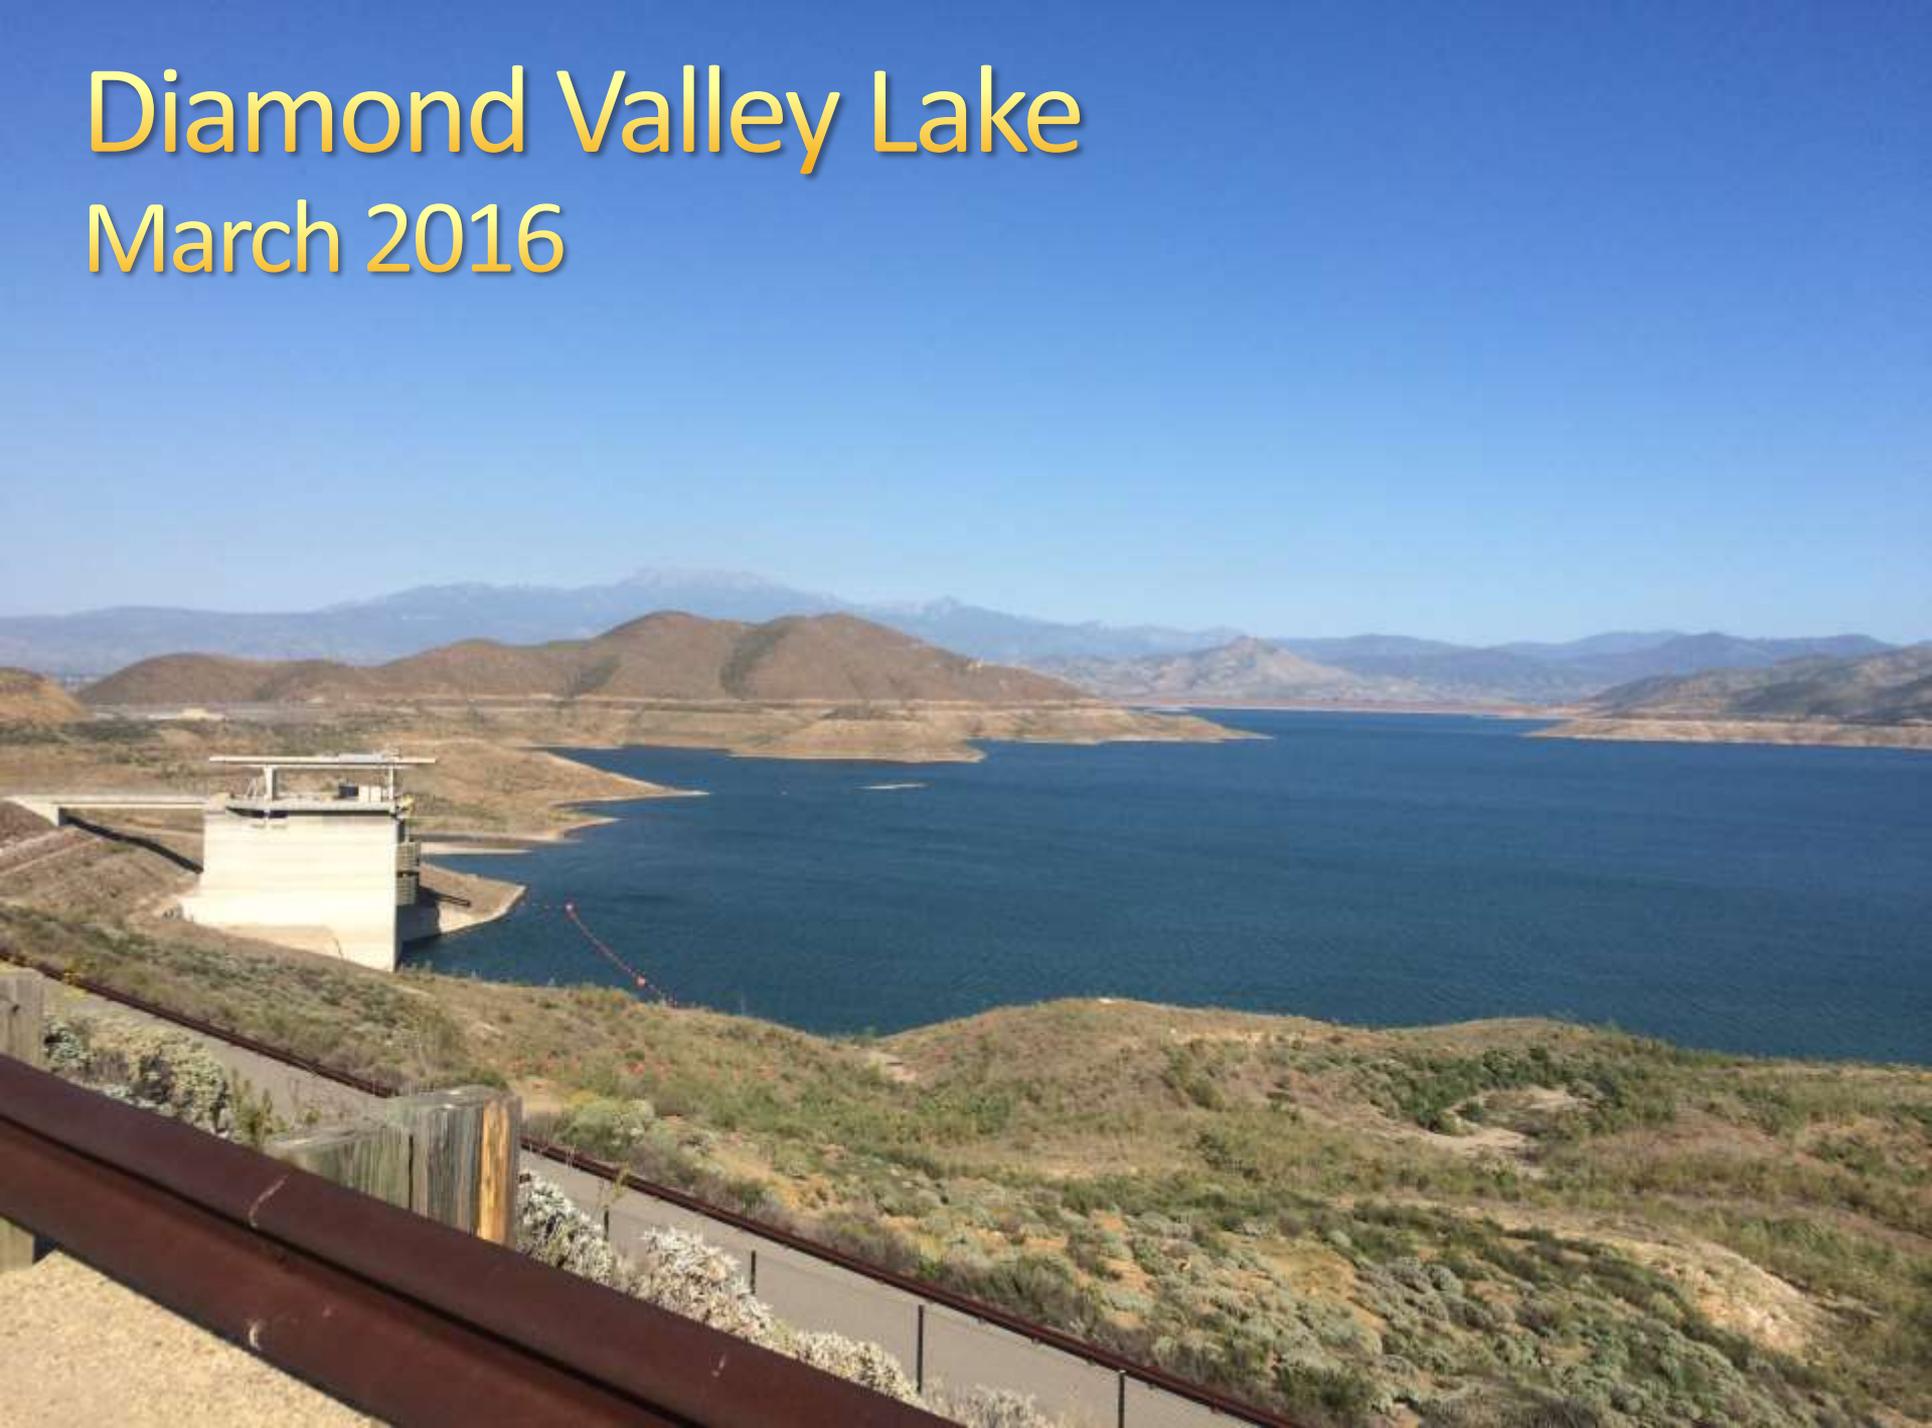

Recent and Upcoming Shutdowns

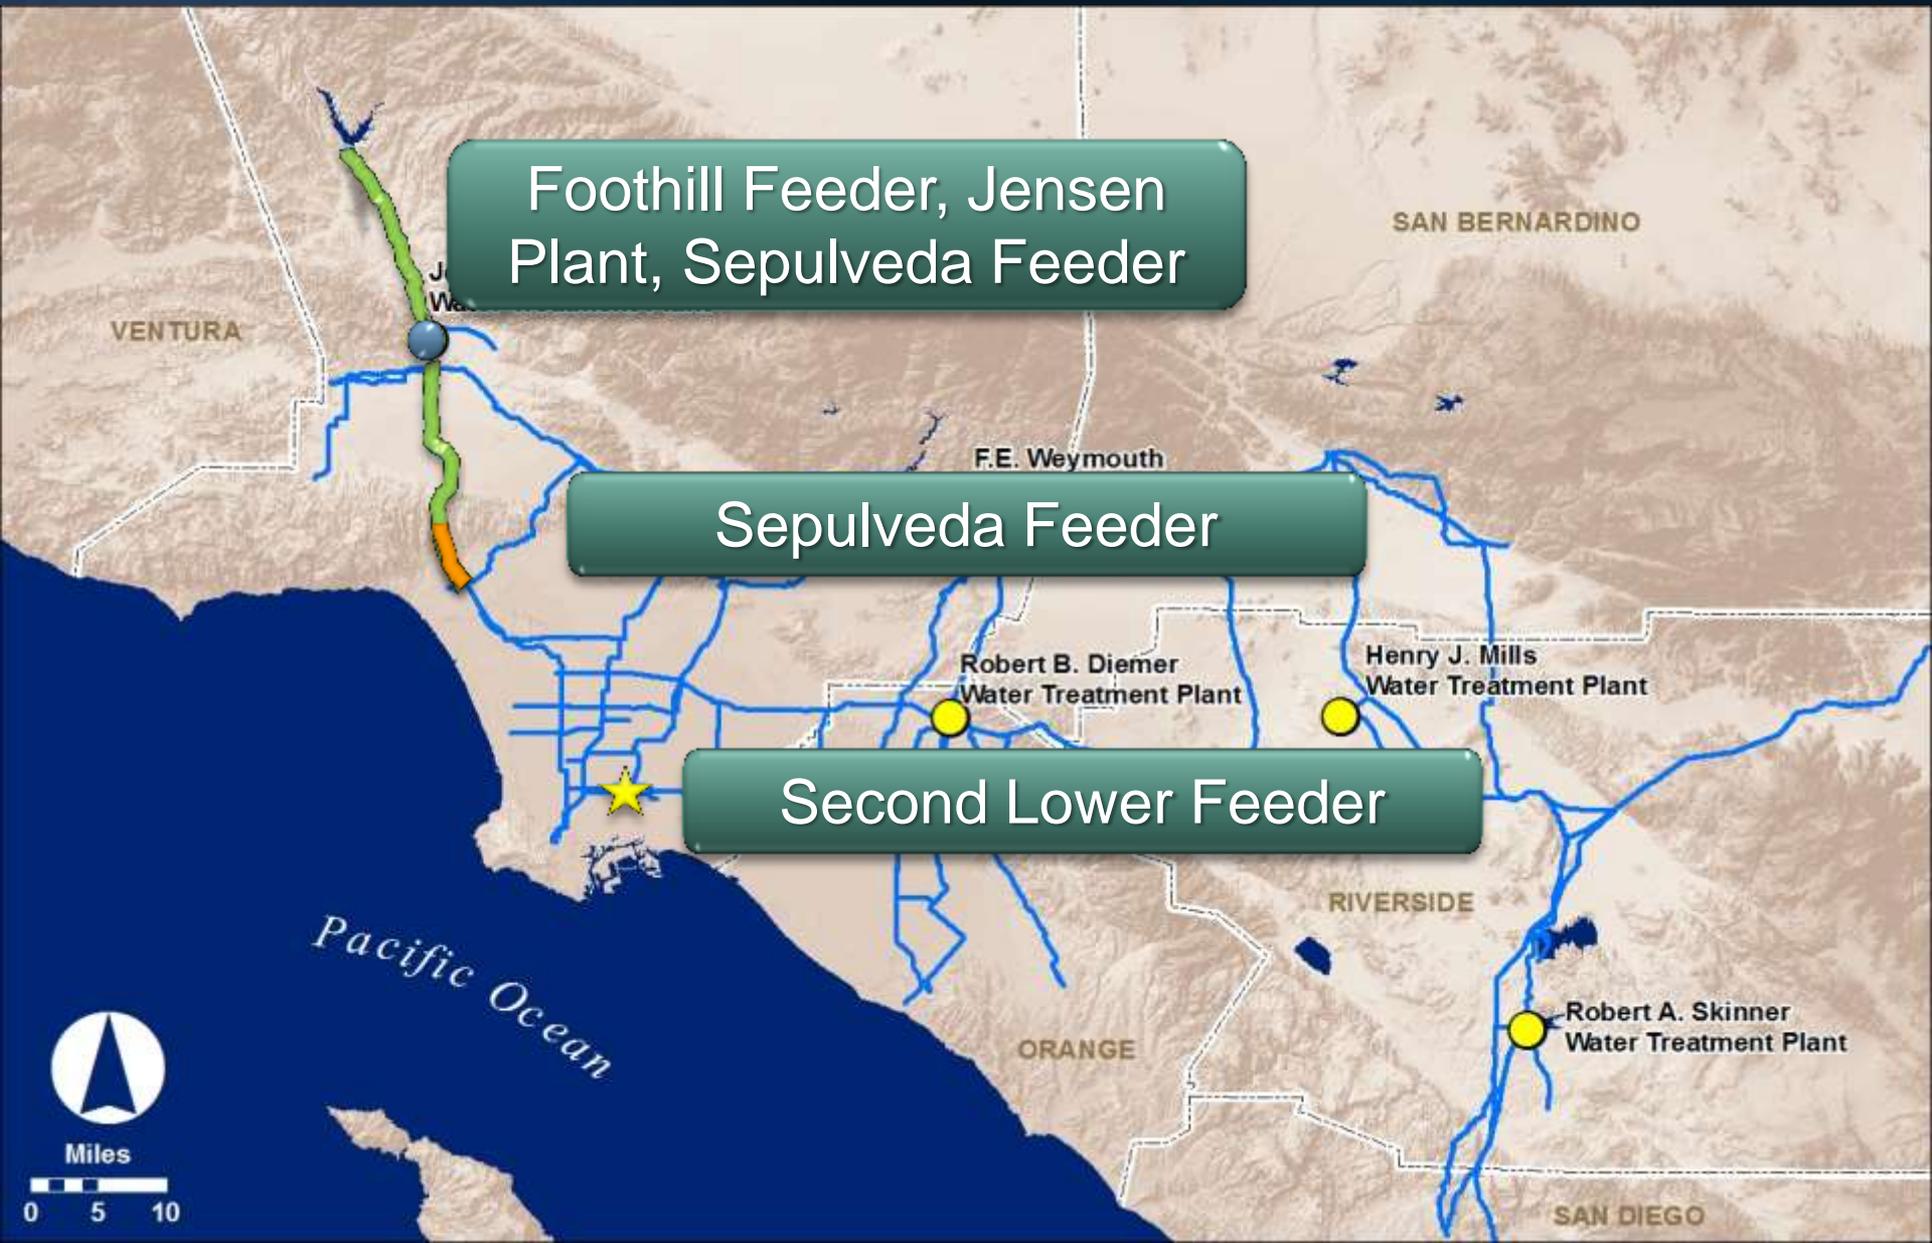

Foothill Feeder, Jensen Plant, Sepulveda Feeder

Sepulveda Feeder

Second Lower Feeder

Second Lower Feeder Repair

Feb 25 – Mar 30, 2016

80 ft lined

Carbon fiber wrap

No agencies impacted



Foothill Feeder Shutdown

- April 5 – 11, 2016



Jensen Treatment Plant Shutdown

- April 5 – 11, 2016



April 2016

Sepulveda Feeder Inspection

- April 5 – 9, 2016



Sepulveda Feeder Urgent Repairs

- April 18 – June 22, 2016
- Approximately 8,300 ft of steel liner



