



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

May 8, 2017

Current Operational Conditions

- 2017 SWP Allocation is 85%
- SWP blend targets are 100% at Weymouth and Diemer
- The Skinner Plant is at 88% SWP blend
- The CRA is currently at a 3 pump flow
- April 2017 deliveries of 107 TAF were 15 TAF lower than April 2016
- Continuing to fill storage based on WSDM principles

Diamond Valley Lake Storage

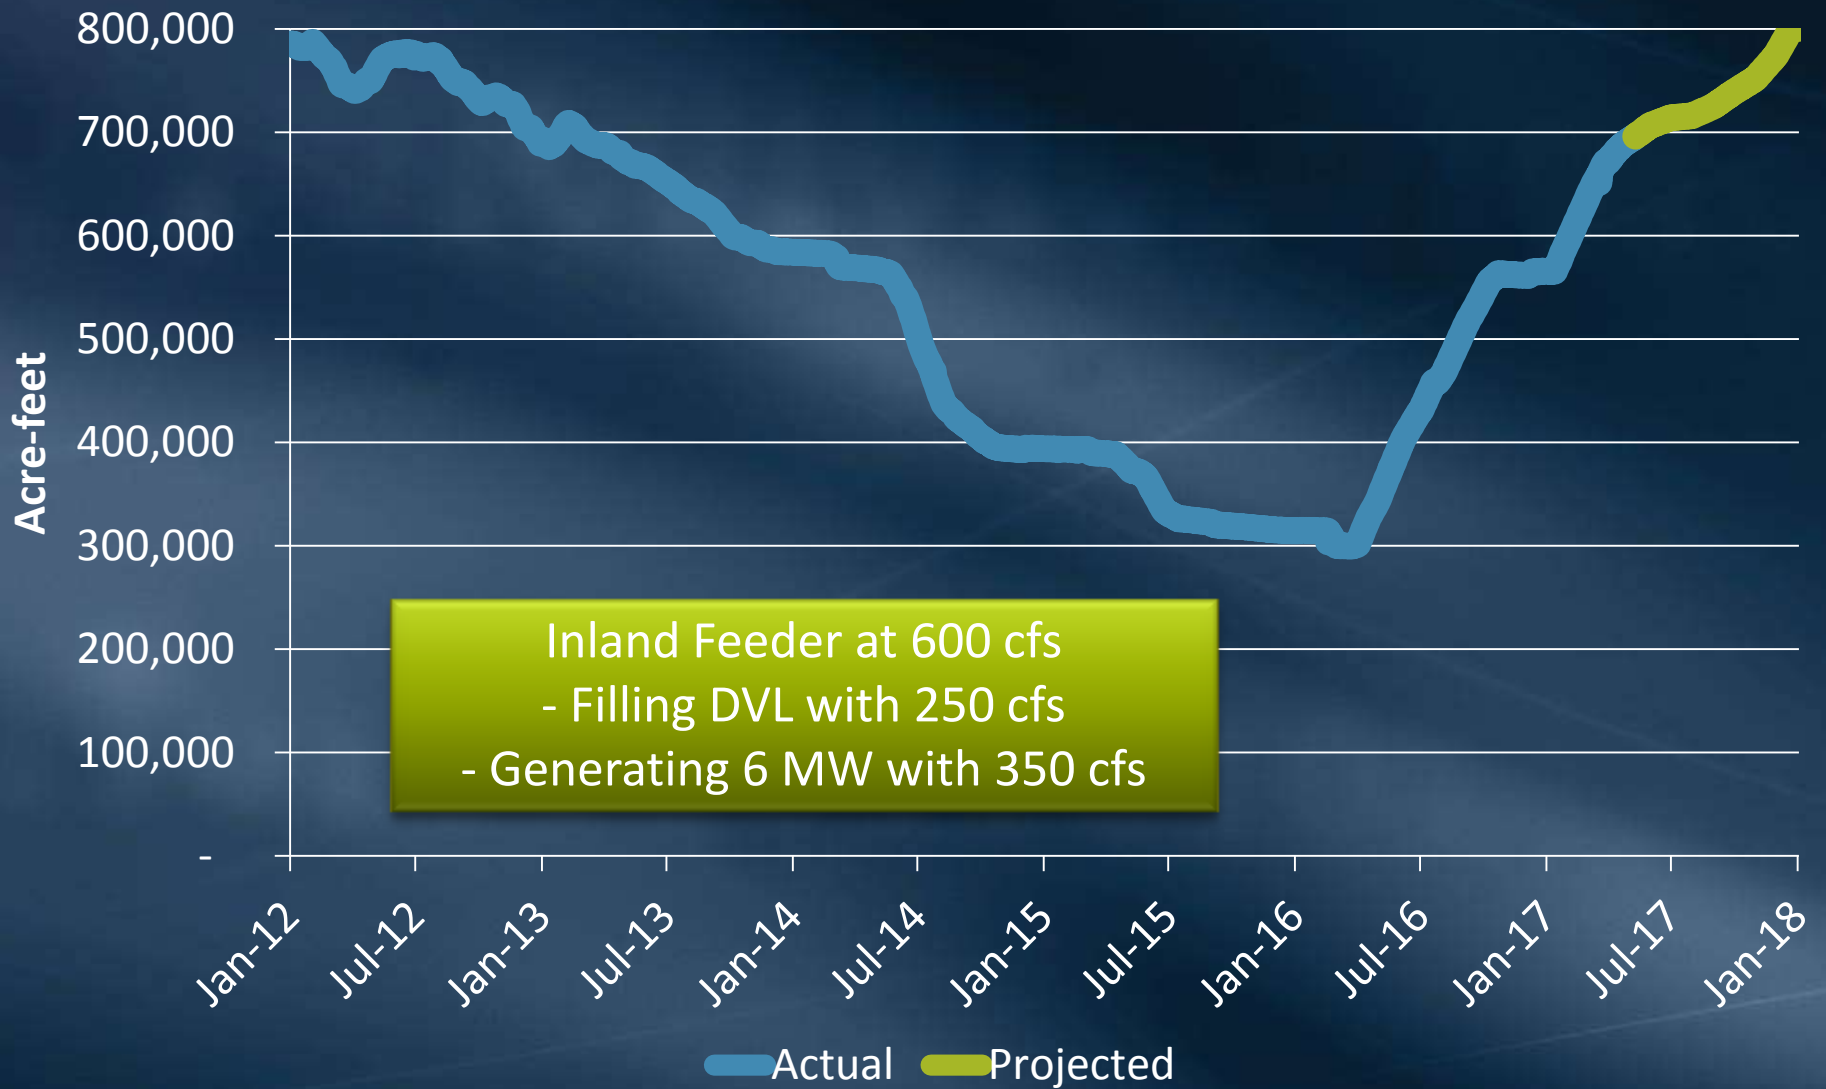

Possible Invasive Mussel Detection

- North Park Valve location on Santa Ana Valley Pipeline and Live Oak Reservoir on Rialto Feeder
- Suspect veligers (larval stages)
- Not detected in reservoirs
 - Lake Silverwood
 - Lake Perris
 - Diamond Valley Lake
- Staff is continuing to work with Fish and Wildlife, DWR, and LA County Department of Public Works to investigate the issue

Possible Invasive Mussel Detection



