



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

December 11, 2017

Current Operational Conditions

- State Water Project Allocation
 - 2017: 85%
 - 2018: 15% (initial)
- SPW blend targets are 75% at Weymouth, Diemer, and Skinner
- CRA is currently at a 7-pump flow
- Continuing to fill storage based on WSDM principles
- November 2017 deliveries of 133 TAF were 27 TAF lower than November 2016

Major Shutdowns in FY 2017-18

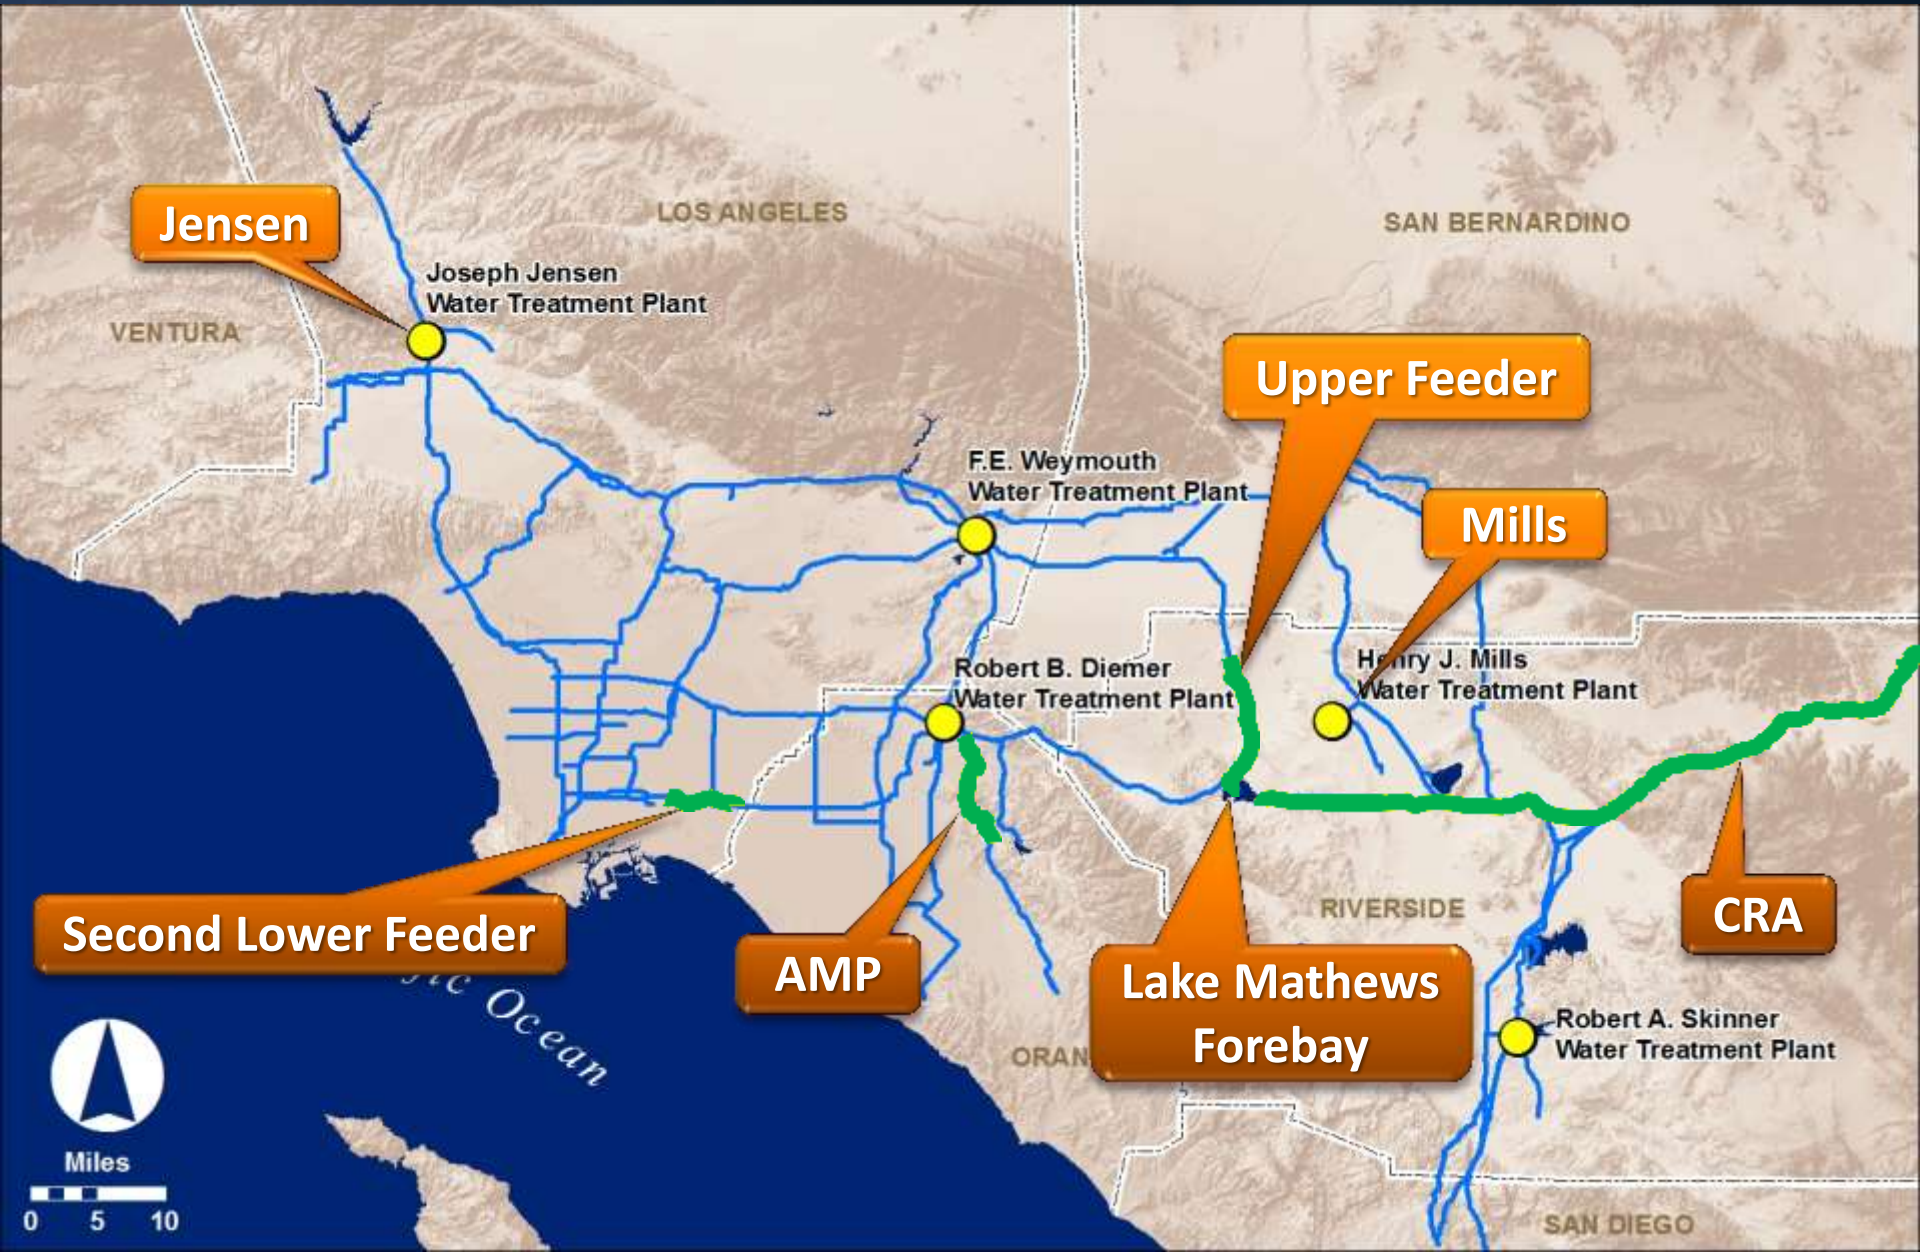

Southern California Fires



Apprenticeship – Class of 2017

- 17 Apprentices
 - 9 Mechanical
 - 8 Electrical
- Completed 7,280 hours of training
 - Classroom instruction
 - Shop training
 - On-the-job training
- Overall GPA is 87 percent
- Completed Demonstrated Proficiency Assessments



Partnership for Safe Water

Phase IV Presidents Award for Jensen Plant



