



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

May 13, 2019

Current Operational Conditions

- 2019 SWP Allocation is 70%
- SWP blend targets are 100% at Weymouth and Diemer plants, and 75% at Skinner plant
- CRA is currently at a 3-pump flow
- Managing storage based on WSDM principles
- April 2019 deliveries of 99 TAF were 38 TAF lower than April 2018
- Maximizing deliveries of SWP supplies

Ensuring Continued System Reliability

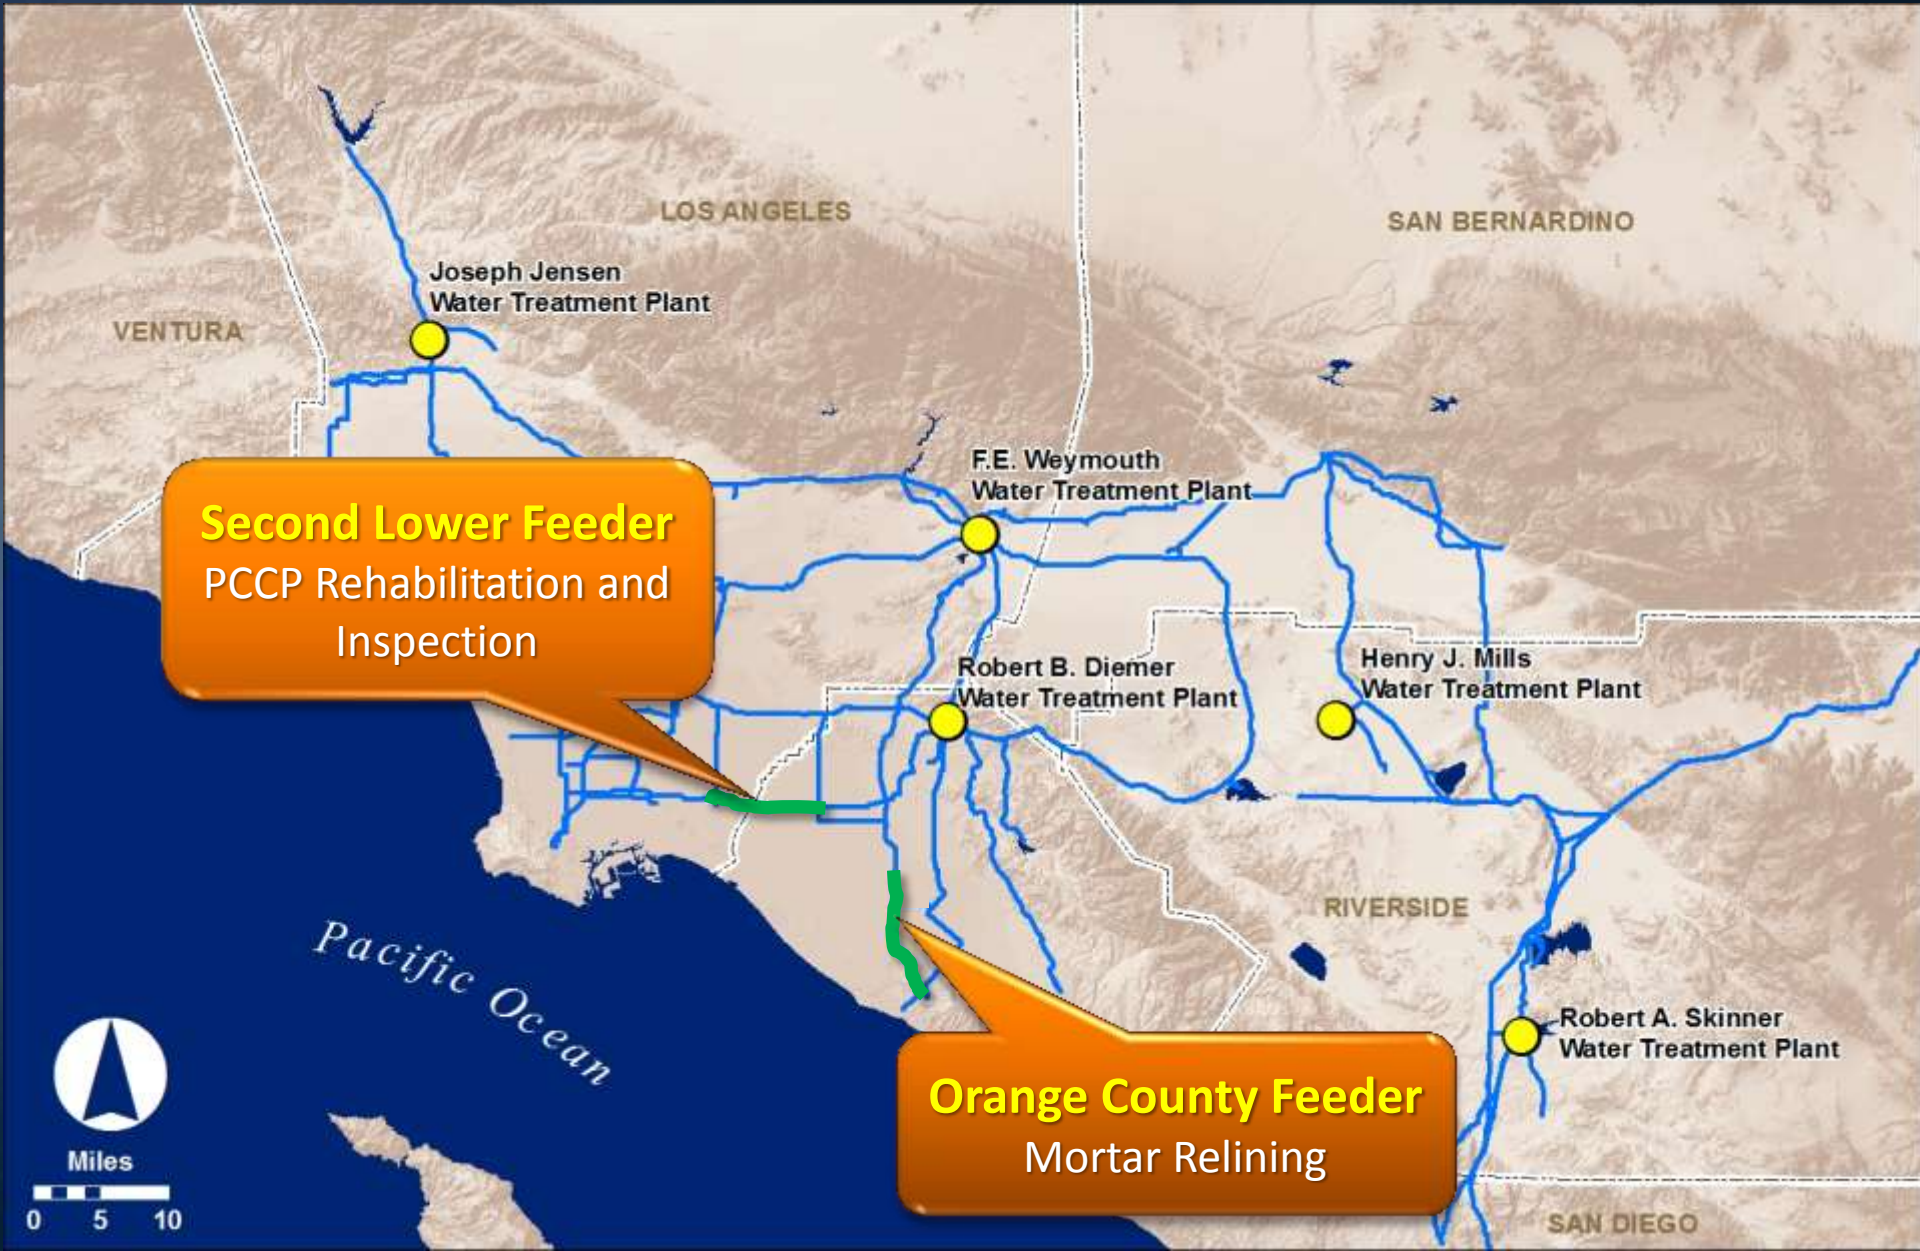

Second Lower Feeder
PCCP Rehabilitation and
Inspection

Orange County Feeder
Mortar Relining

Preparing for Emergencies

Hazardous Materials Full-Scale Emergency Response Exercise



Successful exercise at the Mills plant with over 70 representatives from various agencies that collectively respond to hazmat incidents in Riverside County

Preparing for Emergencies

Joint Infrastructure Security Emergency Response Exercise

- Focused on mutual aid security support following a large earthquake
- Successful tabletop exercise with high-level government emergency management and military officials



2019 WSO Managers Meeting



This annual meeting allows WSO managers to reconnect, learn, reflect, and share ideas for continued effectiveness in delivering high quality water supplies

2019 WSO Managers Meeting

Maintenance and Safety Awards



Desert

**Best Overall Maintenance
in Conveyance & Distribution**



Diemer

Best Overall Maintenance in Treatment



Diemer

Best Safety Performance

