



Water System Operations Manager's Report

Engineering and Operations Committee

Item 7a

June 10, 2019

Current Operational Conditions

- 2019 SWP Allocation is 70%
- SWP blend targets are 100% at Weymouth and Diemer plants, and 75% at Skinner plant
- CRA is currently at a 4-pump flow
- Managing storage based on WSDM principles
- May 2019 deliveries of 101 TAF were 26 TAF lower than May 2018
- Maximizing deliveries of SWP supplies

Hosted Family of Past General Manager Henry J. "Hank" Mills



Award Winning Innovation in Water Quality Technology


Real-Time
Distribution System
Water Quality Monitoring
Utilizing Mobile Technology



Staff Receiving Tech Innovation Award at
Special Districts Summit

Award Winning Publication

Recognized as the **“Highest Rated Publication”**
and **“Best Paper Published”** in the AWWA Journal

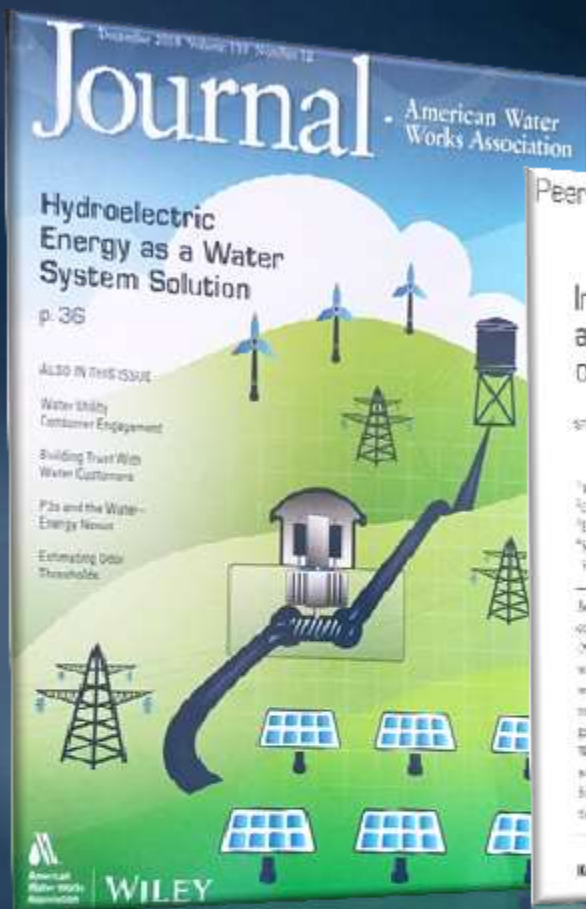

Metropolitan’s Water Quality Research Paper
was awarded the 2019 Publications Award
by the American Water Works Association

