



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

May 10, 2021

Current Operational Conditions

- 2021 SWP Allocation is 5%
- SWP blend targets are 0% at Weymouth, Diemer, and Skinner plants
- CRA is at 8-pump flow
- Managing storage based on WSDM principles
- April 2021 deliveries of 137 TAF were 48 TAF higher than April 2020


Ensuring Continued System Reliability

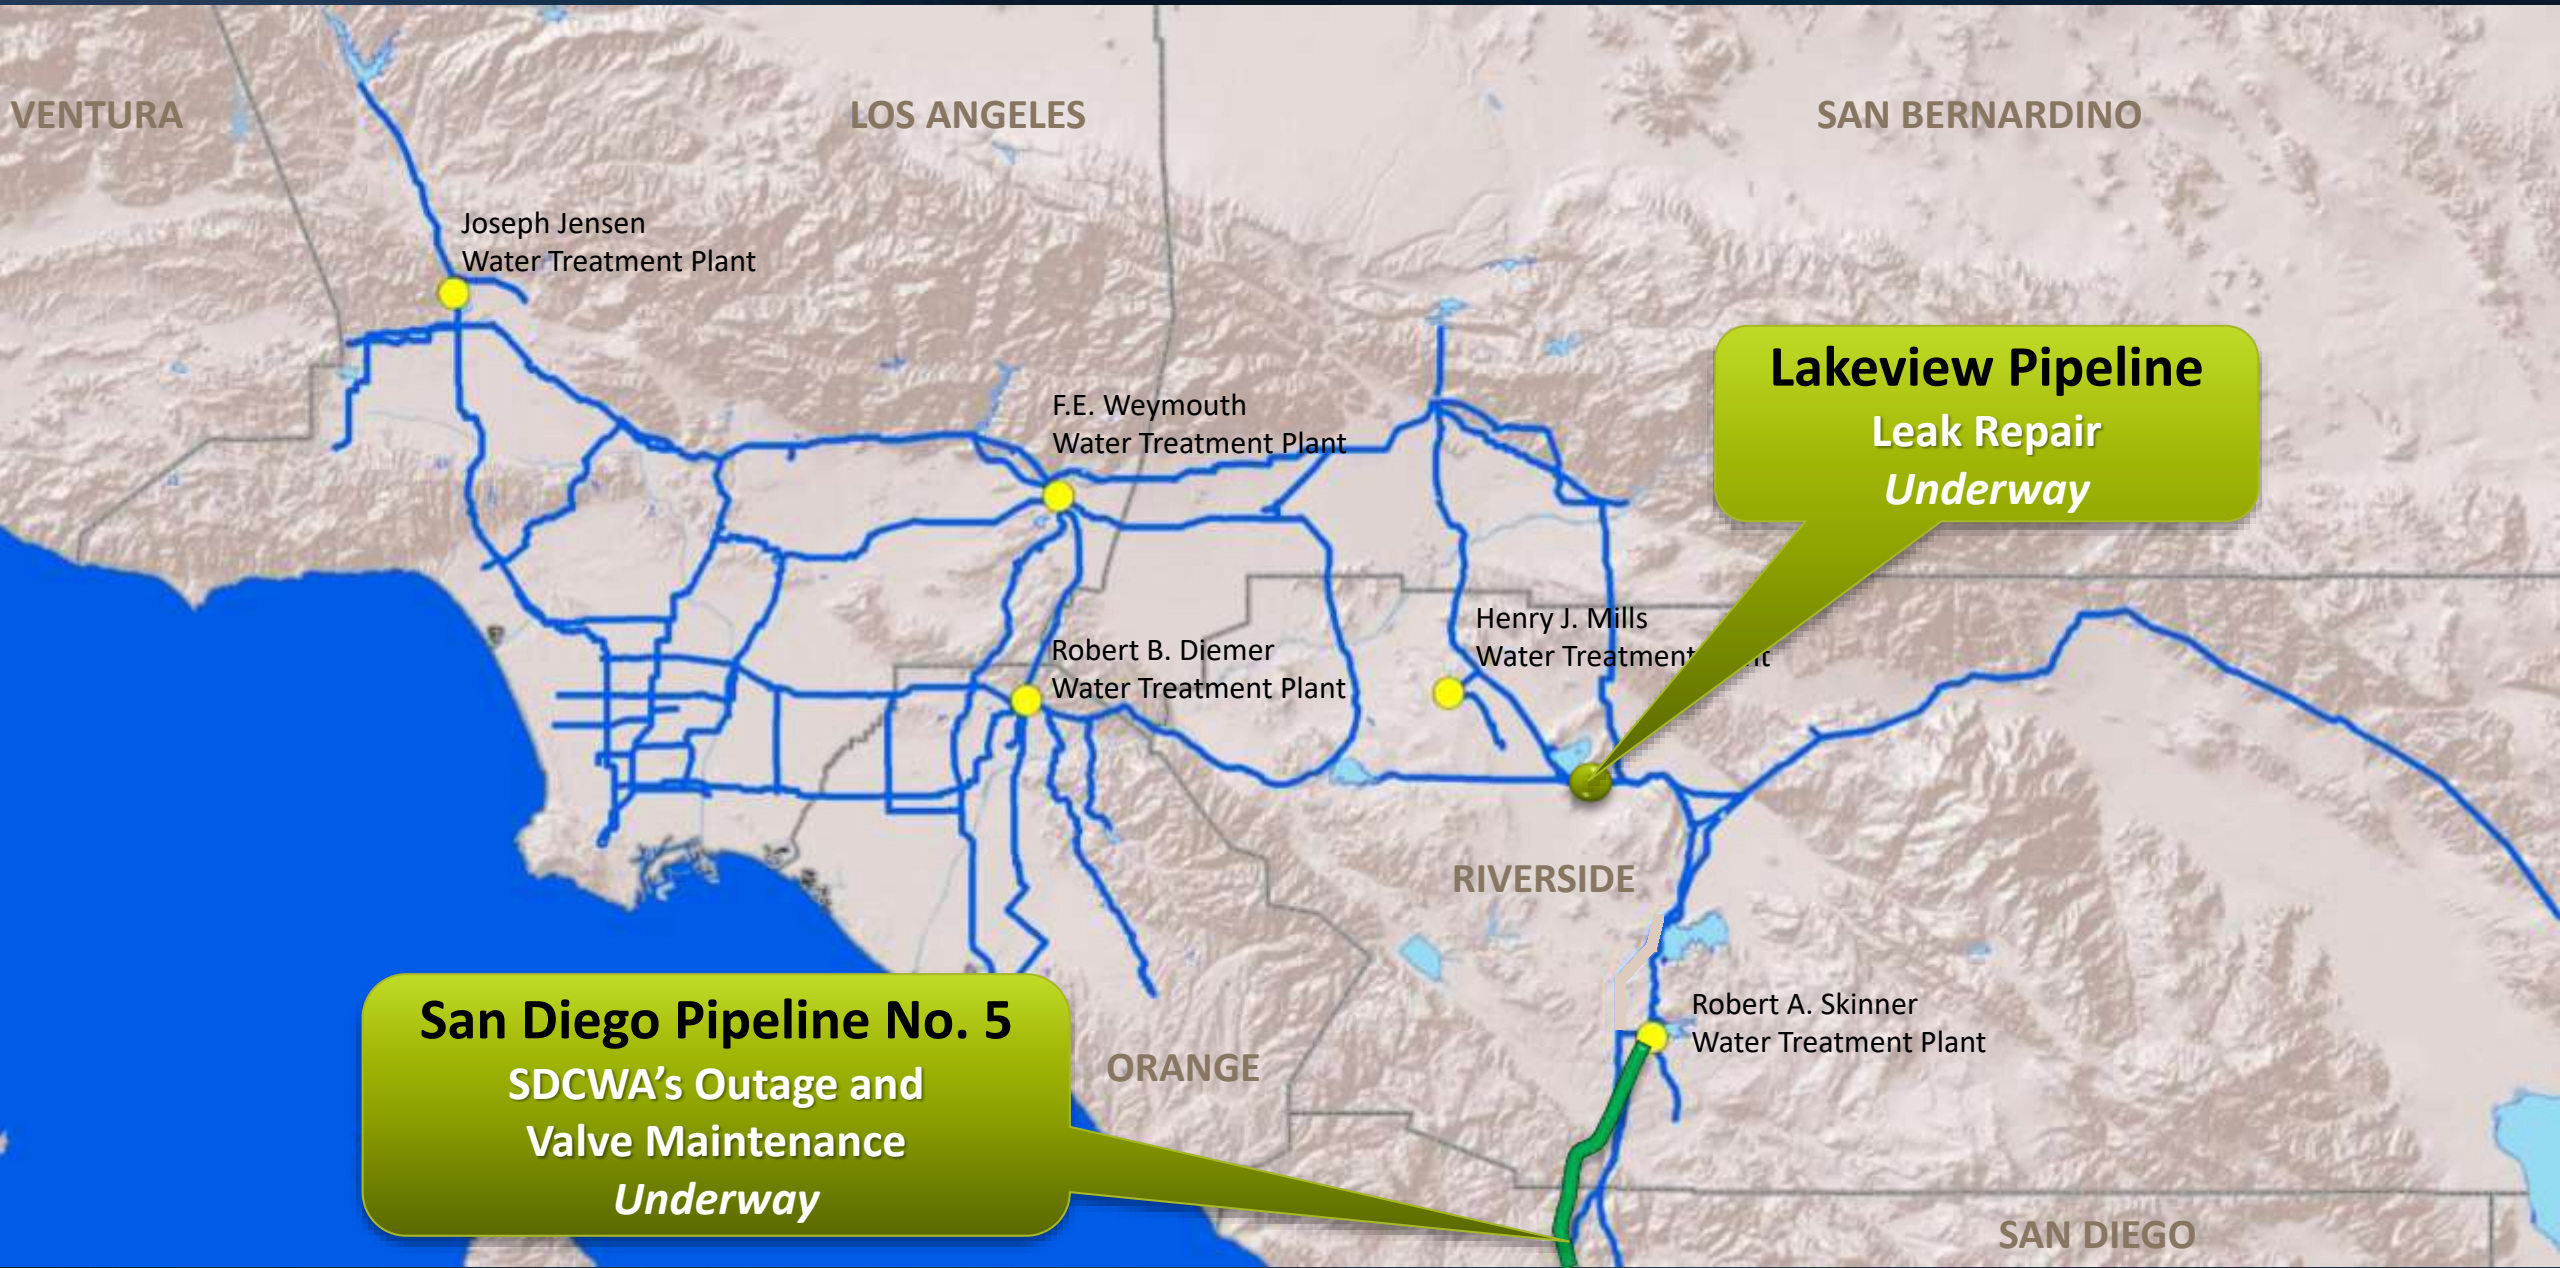

Lakeview Pipeline
Leak Repair
Underway

San Diego Pipeline No. 5
SDCWA's Outage and
Valve Maintenance
Underway

Lakeview Pipeline Leak Repair

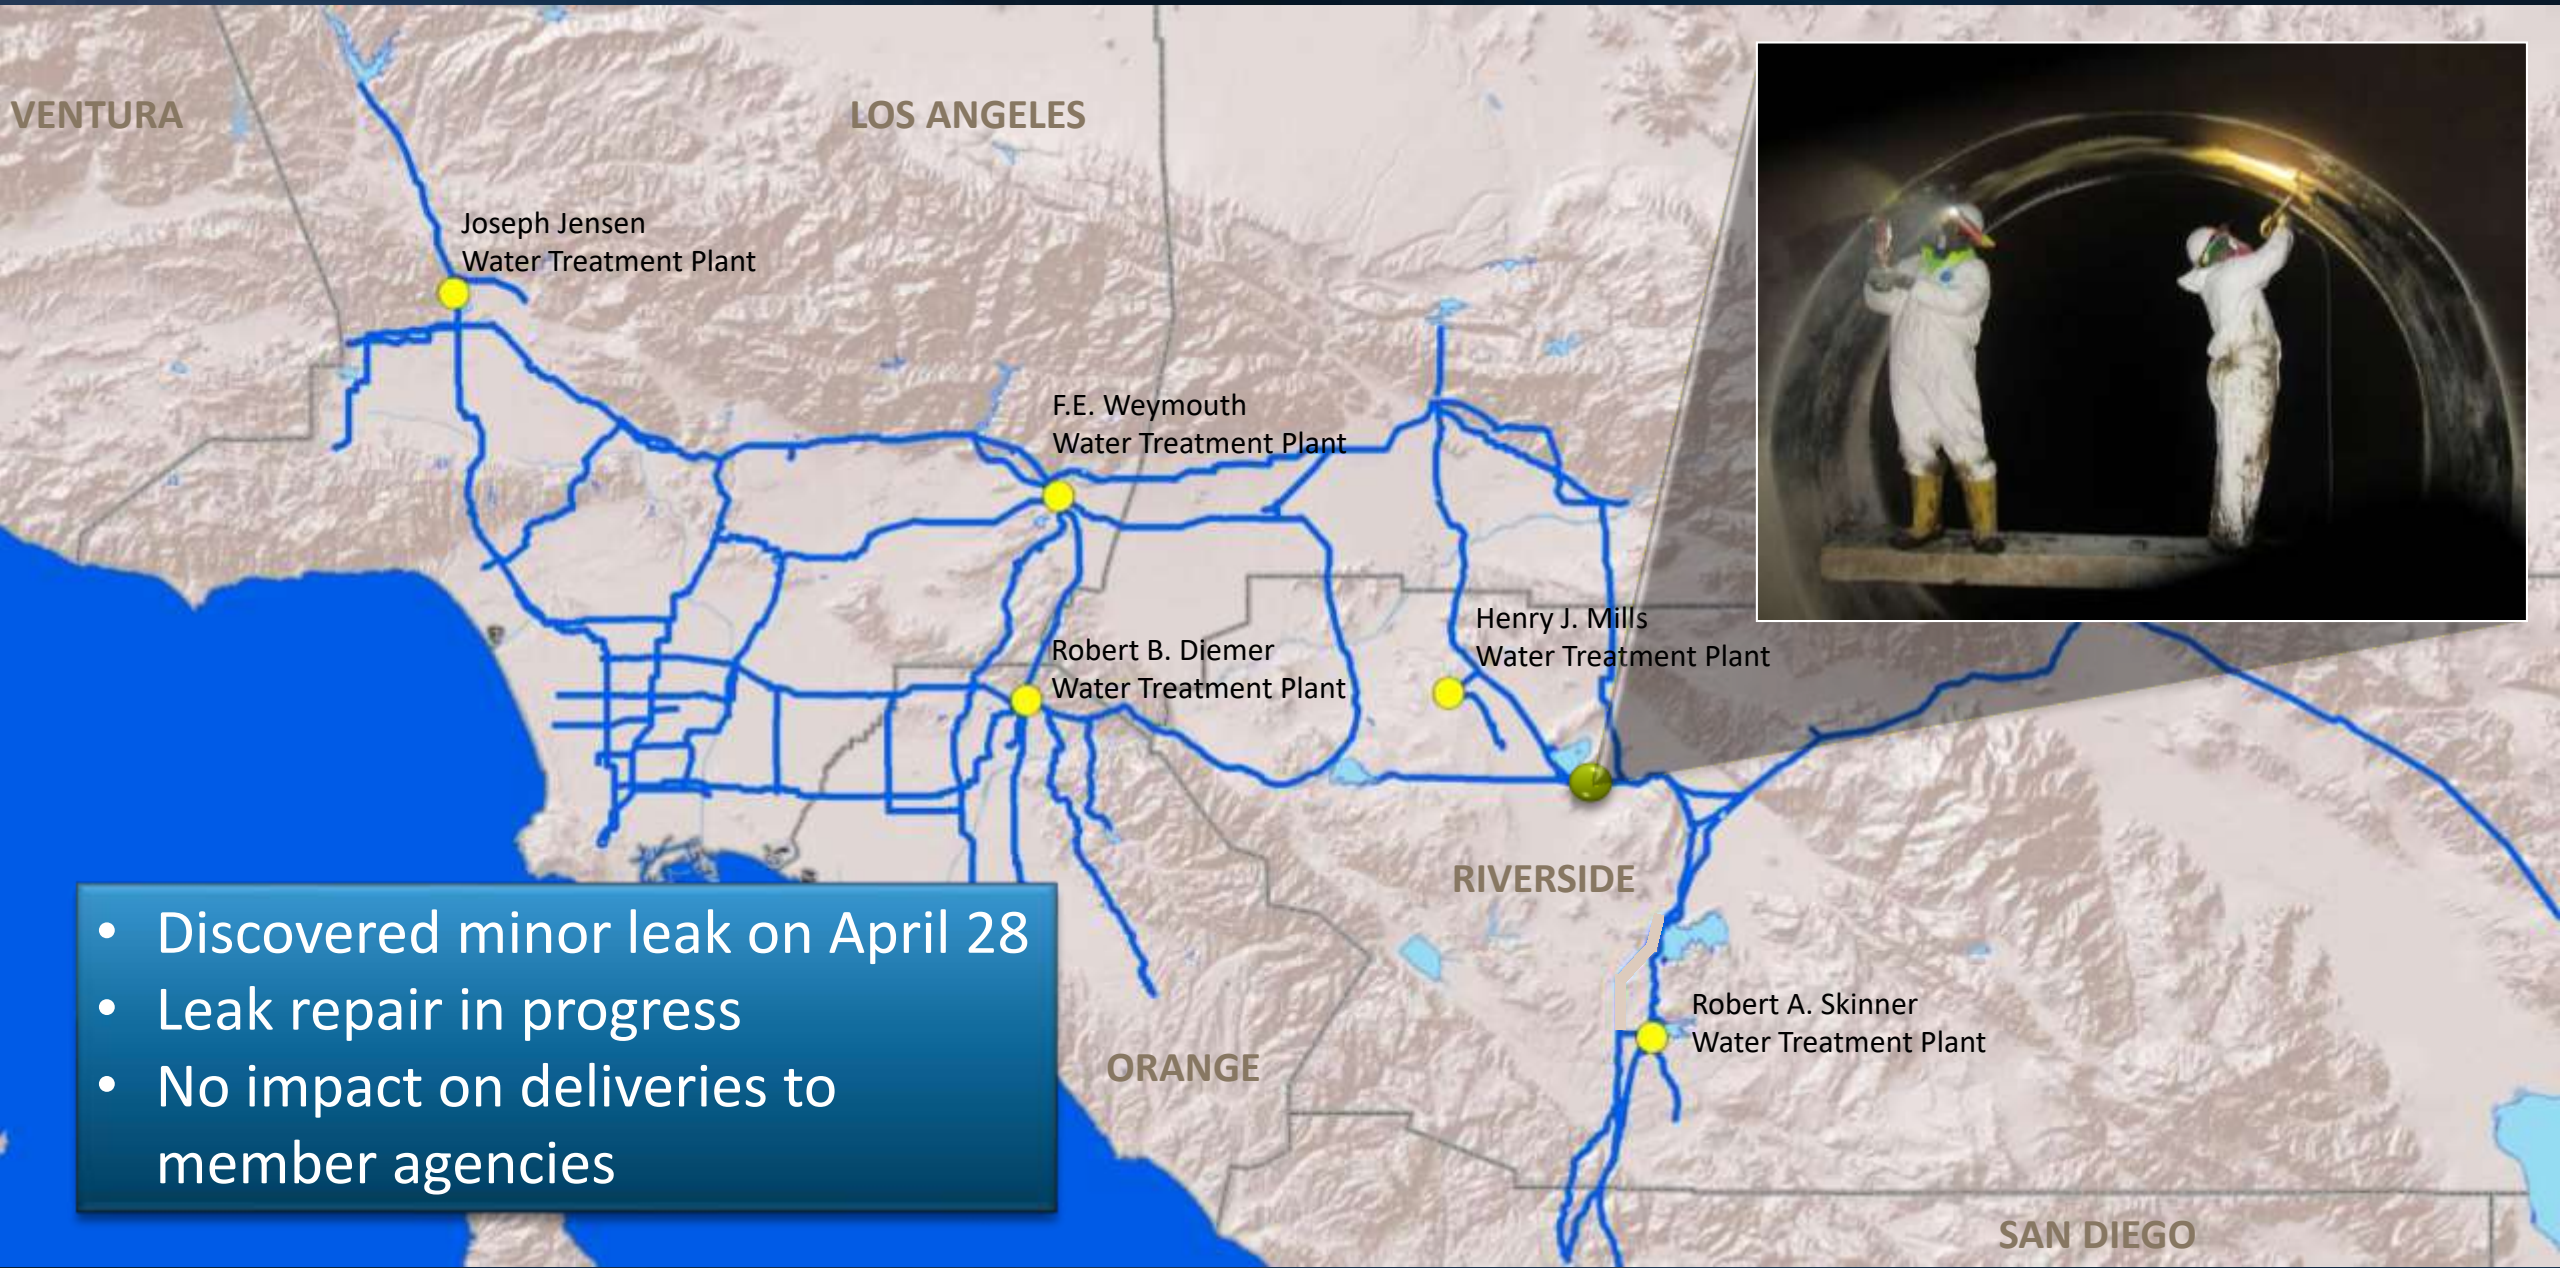

- Discovered minor leak on April 28
- Leak repair in progress
- No impact on deliveries to member agencies

Maximizing Reliability: Extraordinary Drought Actions

Delivering DVL Water to Mills Plant



Supply Mills plant demands from DVL (starting mid-May)

Reporting Injuries to Cal/OSHA



- Metropolitan maintains a goal of zero injuries
- “Serious Injuries” are immediately reported to Cal/OSHA per regulation
 - **Reportable** injuries involve inpatient hospitalization other than for observation or diagnostic testing
 - Other injuries may be **recordable** (e.g., days away from work, medical treatment beyond first aid)
- An injury could be deemed **reportable** at a later date (based on severity) and would be reported to Cal/OSHA at that time
- Cal/OSHA is also informed of **recordable** injuries on an annual basis

Reporting Injuries at Metropolitan

- Injuries are reported in Metropolitan's Incident Reporting System
- Cal/OSHA *reportable* injuries are discussed with Metropolitan Board
 - Employee hand injury at Lake Mathews shutdown reported at April E&O
 - First Cal/OSHA reportable injury in over four years
- Recent example of employee lower leg injury during Perris facilities shutdown is recordable, but not Cal/OSHA reportable
- Injury rates and other safety metrics reported annually during Metropolitan's Health and Safety Program Update

Tracking Metropolitan's Injury Rate

